


- NOTES: 1. INSTALL IN ACCORDANCE WITH AIRFLOW DIRECTION INDICATOR.
2. FOR QTY. OF PROBES & SENSORS PER PROBE SEE SCHEDULE.
3. FOR UNITS WITH TWO PROBES, USE LOCATIONS A1 & A3 ONLY.
4. FOR PROBES 14" LONG OR LESS ARE CAPPED WITH NO STUDS OR NUTS PROVIDED. IN THIS CASE, NO (5/16") HOLE SHOULD BE DRILLED.

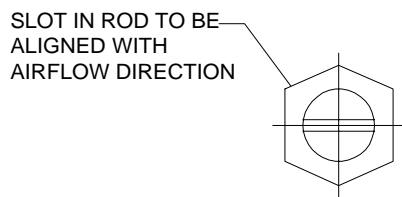

SECTION A-A  
PROBE ALIGNMENT  
SLOT REQUIRED FOR  
ALL BARS.

INSULATION REQUIREMENTS				
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
NONE	0.5 INCH	1 INCH	2 INCHES	3 INCHES

SELECTION OF MATERIALS FOR CONSTRUCTION			
<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
ALUMINUM & ABS	CPVC & ABS	304 STAINLESS STEEL	HIGH. TEMP STEEL